In-Production Photo Report for

Fenton Township Fire Department, MI

Job# 45142 : PWO# 34872053


Status as of August 21, 2026

In this report your commercial chassis and pump house remained staged, the tank completed chevron application, and the body was staged. In the next report your chassis may begin preparations for fire and emergency use, the pump house may continue initial assembly, the tank may be staged, and the body may remain staged to begin initial assembly.

Pierce
An Oshkosh Corporation Company

Find us on Facebook

RELIANT · FIRE · APPARATUS

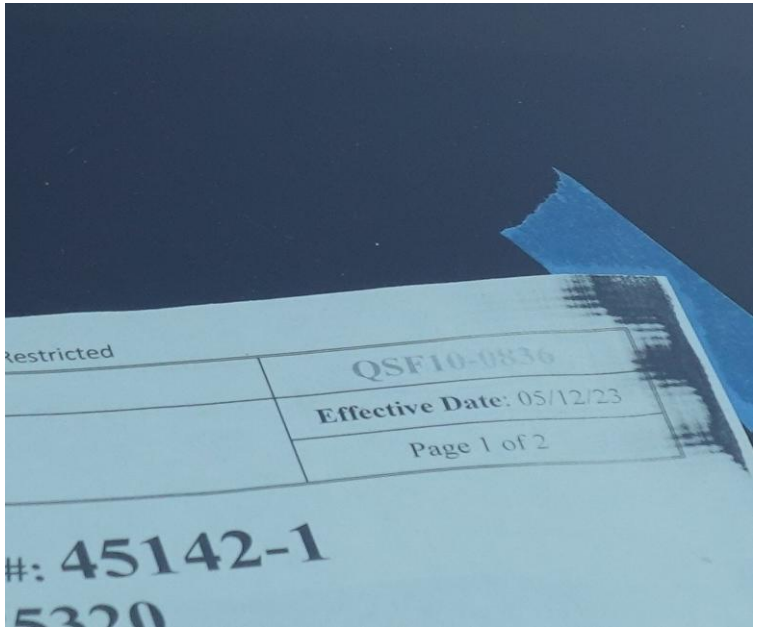

DSC06442



DSC06443



DSC06444



DSC06445




DSC06446



DSC06040



DSC06041

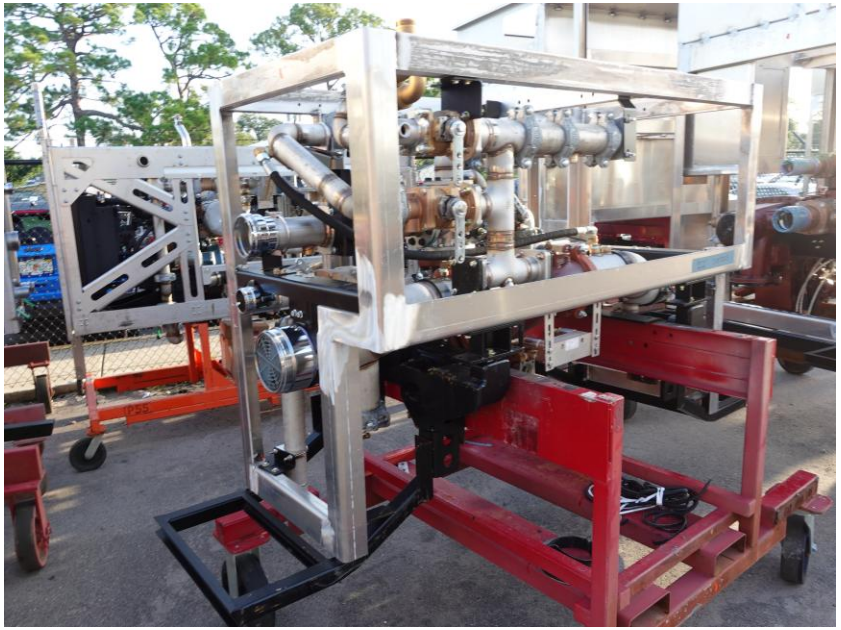


DSC06042



DSC06043



DSC06044

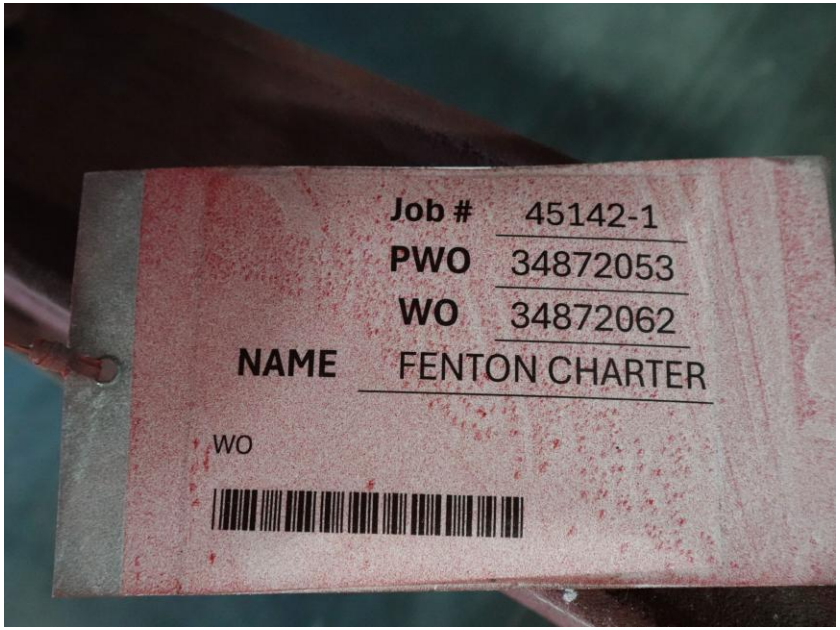

DSC06266



DSC06267




DSC06268



DSC06269



DSC06270

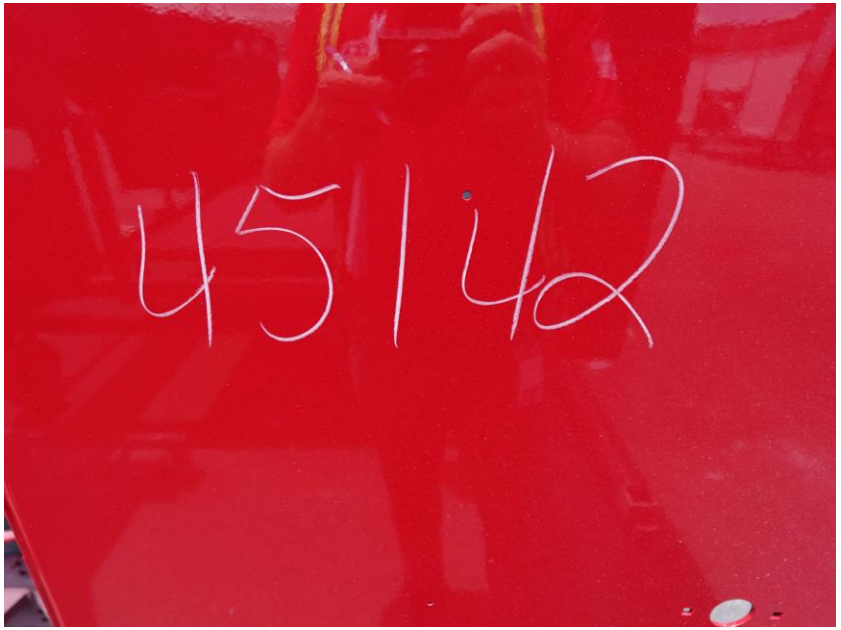

DSC06161



DSC06162



DSC06163



DSC06164



DSC06165

https://reliantfire.com/

Find us on Facebook

An Oshkosh Corporation Company