In-Production Photo Report for

Town of Minocqua Fire Department, WI

Job# 45349 : PWO# 35074263

Status as of August 28, 2026

In this report your commercial chassis and tank were staged while the pump house continued initial assembly, and the body began fabrication. In the next report the chassis may remain staged to begin preparations for fire and emergency use, the pump house may continue initial assembly, the tank may remain staged, and the body may complete fabrication and begin the paint process.

Pierce
An Oshkosh Corporation Company

Find us on Facebook

RELIANT FIRE APPARATUS

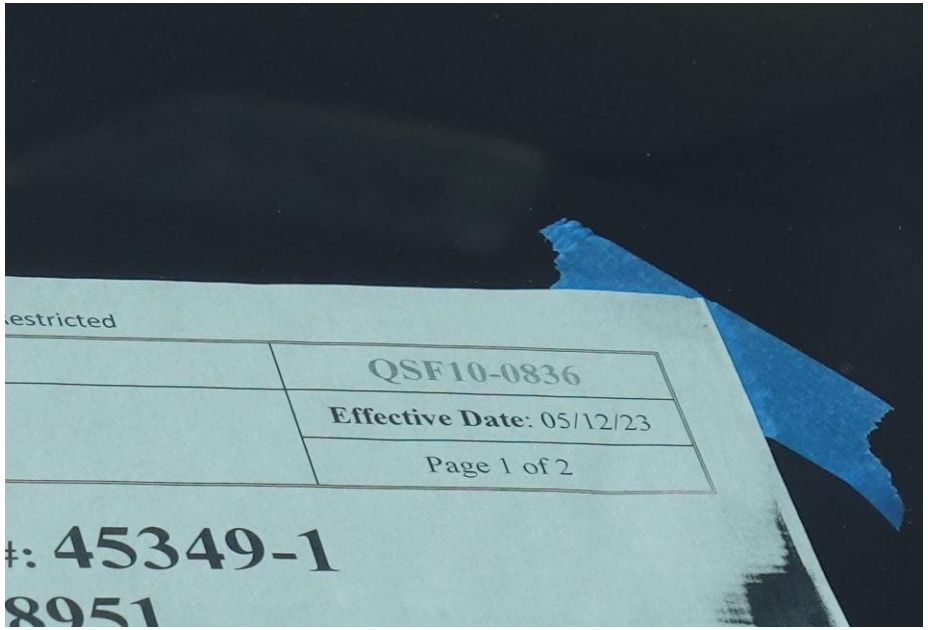

DSC06432



DSC06433



DSC06434



DSC06435



DSC06436

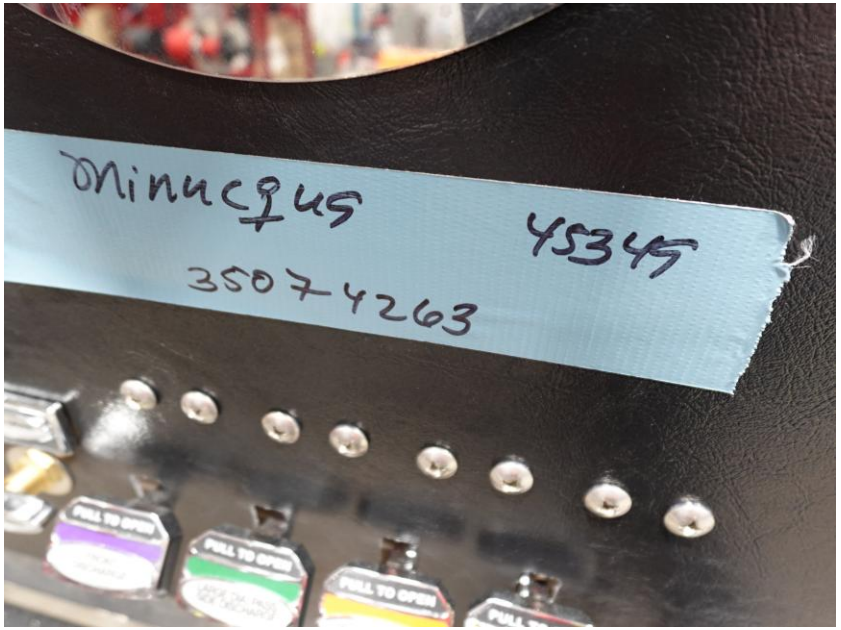

DSC06447

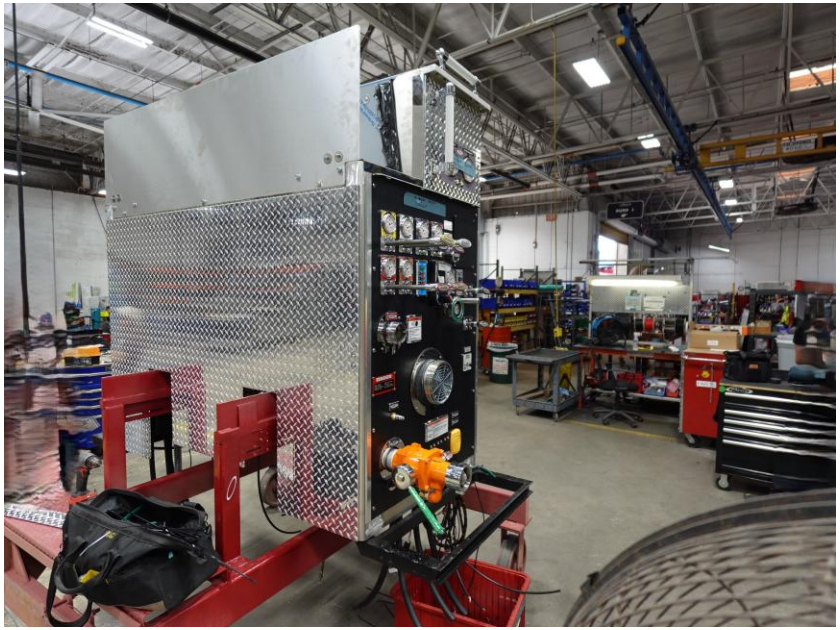

DSC06448



DSC06449



DSC06450



DSC06451

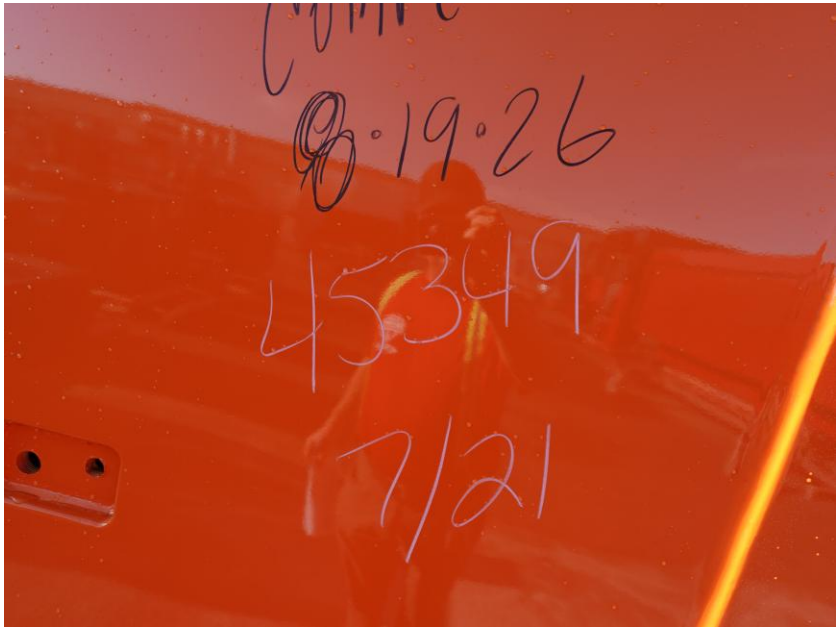

DSC06205



DSC06206



DSC06207



DSC06208



DSC06209

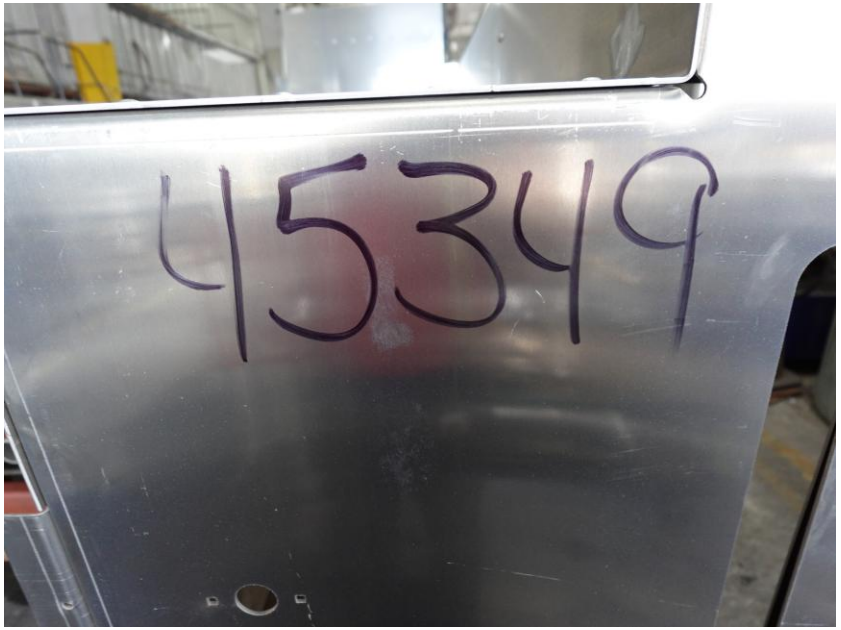

DSC06397



DSC06398



DSC06399



DSC06400



DSC06401

https://reliantfire.com/

Find us on Facebook

An Oshkosh Corporation Company