In-Production Photo Report for

Chetek Fire Department, WI

Job# 45297 : PWO# 35021189


Status as of July 31, 2026

In this report your chassis prep began, the pump house continued initial assembly, and the tank and the body remained staged. In the next report your chassis may continue preparation for fire and emergency use, the pump house complete initial assembly, the tank may remain staged, and the body may begin initial assembly.

Pierce
An Oshkosh Corporation Company

Find us on Facebook

RELIANT · FIRE · APPARATUS · FRA

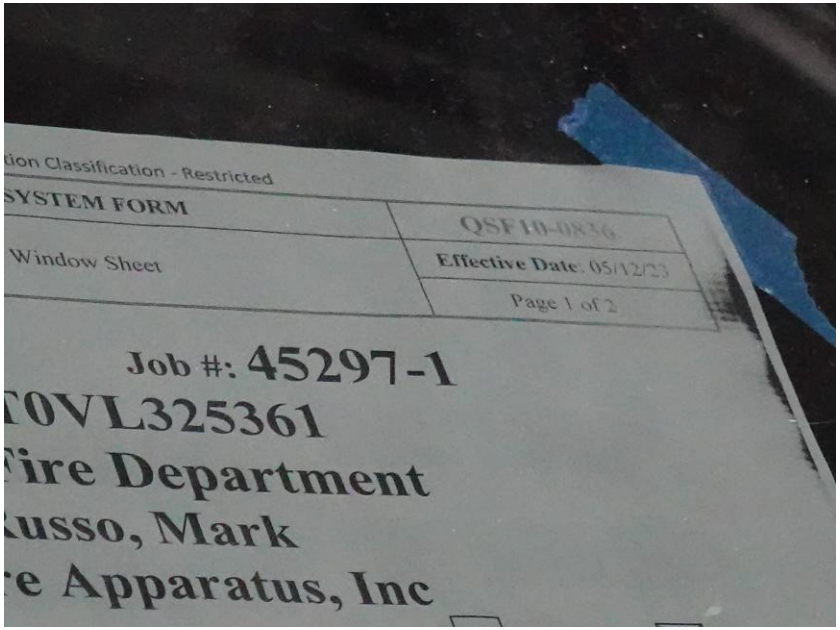

DSC06458



DSC06459




DSC06460



DSC06461




DSC06462

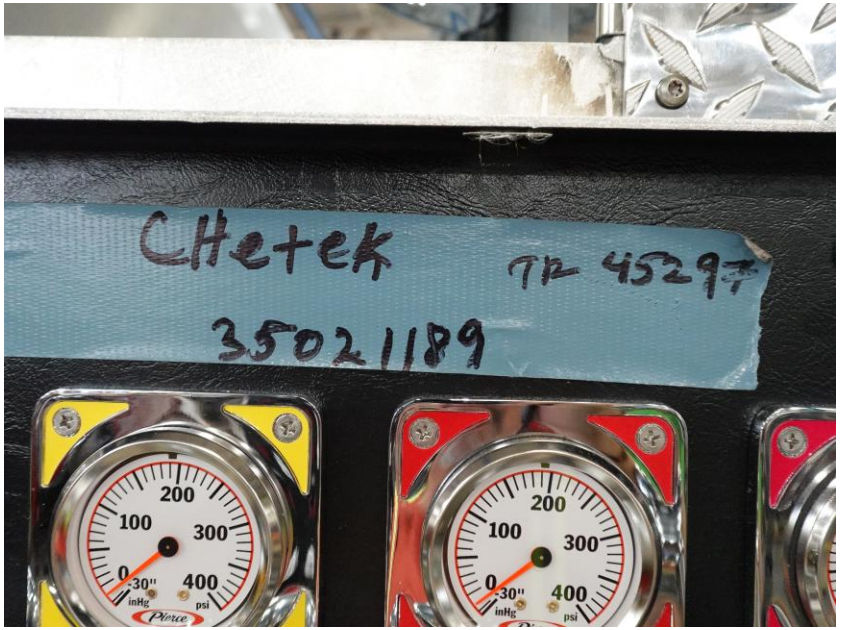

DSC06314



DSC06315

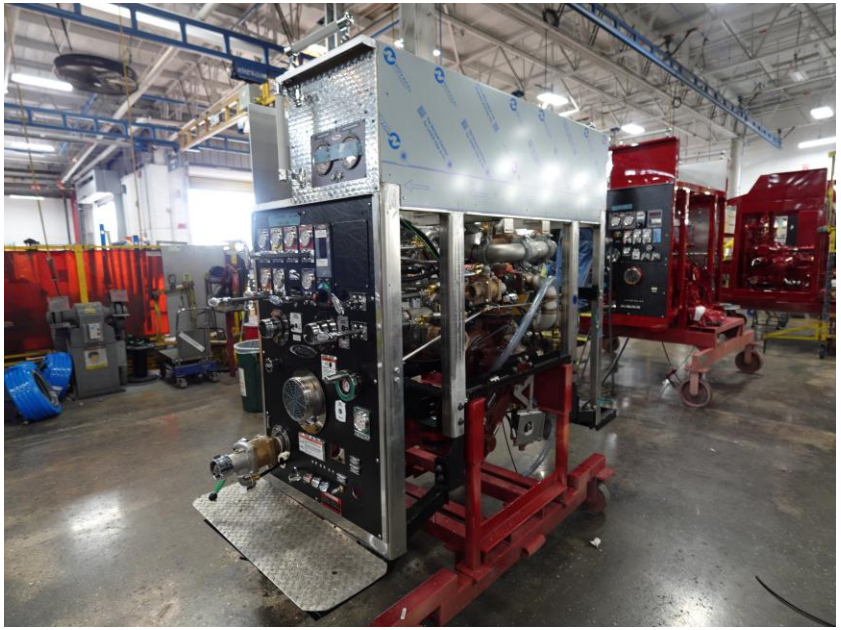


DSC06316



DSC06317



DSC06318

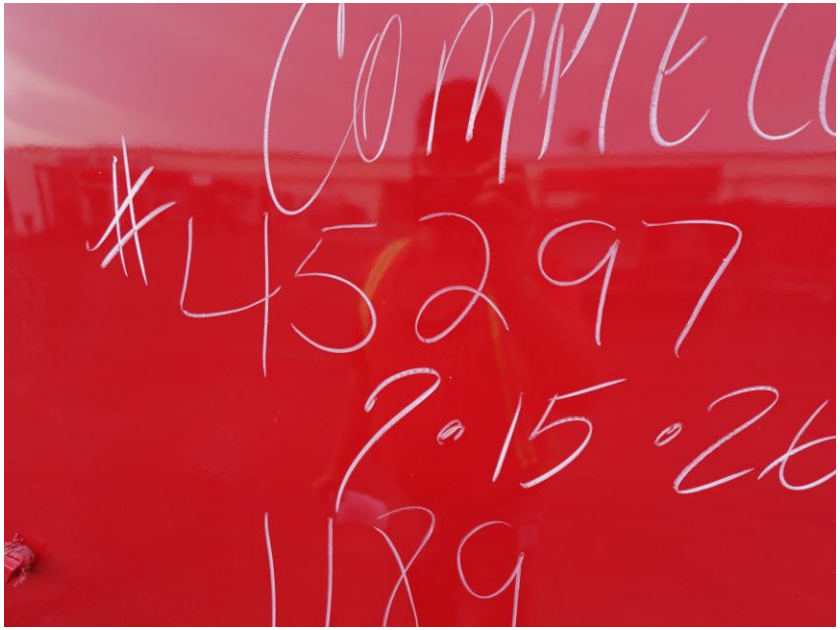

DSC06183



DSC06184




DSC06185



DSC06186



DSC06187

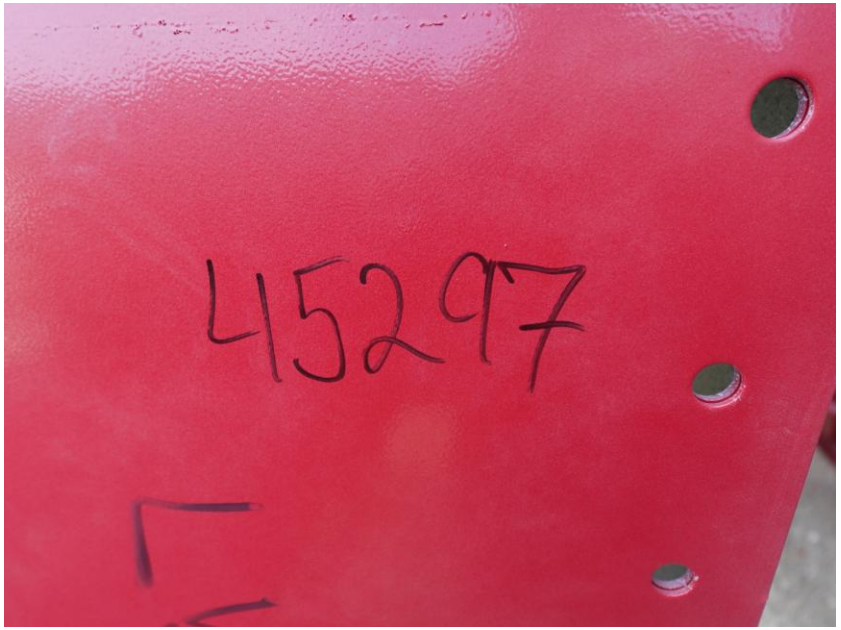

DSC06061



DSC06062



DSC06063



DSC06064



DSC06065

https://reliantfire.com/

Find us on Facebook

An Oshkosh Corporation Company