In-Production Photo Report for

Chetek Fire Department, WI

Job# 45297 : PWO# 35021189


Status as of August 07, 2026

In this report your apparatus continued preparation for fire and emergency use, the pump house continued initial assembly, the tank remained staged, and the body began initial assembly. In the next report chassis prep may continue, the pump house complete initial assembly, the tank may remain staged, and the body may complete initial assembly.

Pierce
An Oshkosh Corporation Company

Find us on Facebook

RELIANT · FIRE · APPARATUS

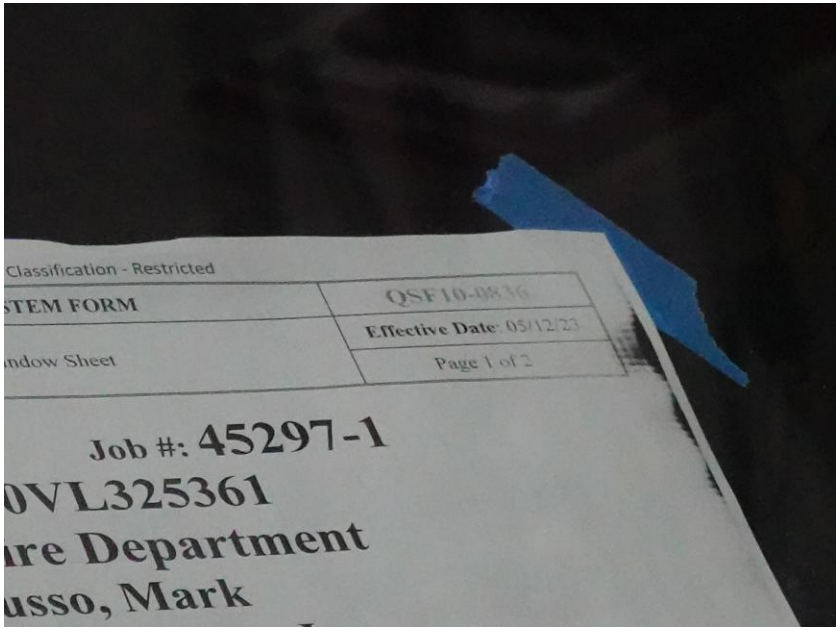

DSC06867



DSC06868




DSC06869



DSC06870



DSC06871

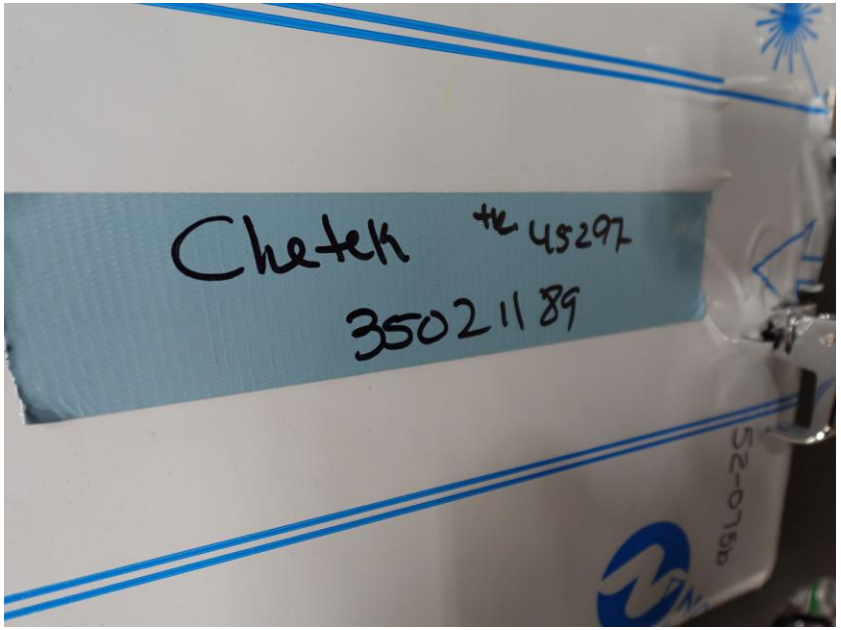


DSC06276




DSC06277




DSC06278

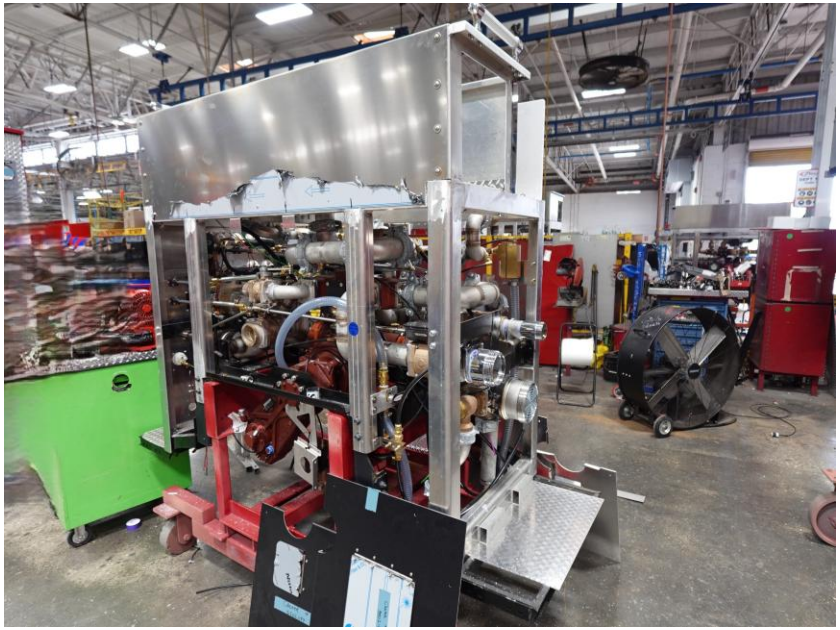

DSC06279

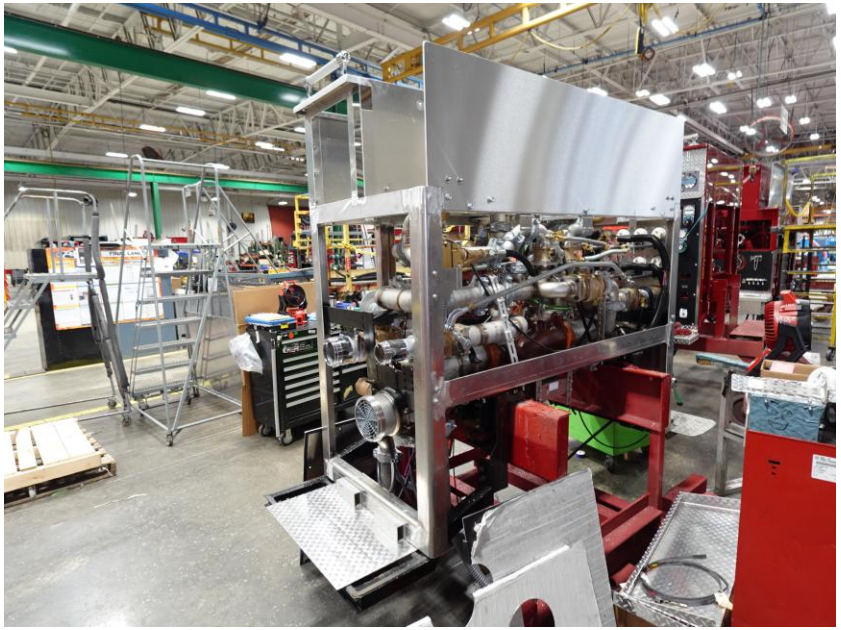

DSC06280

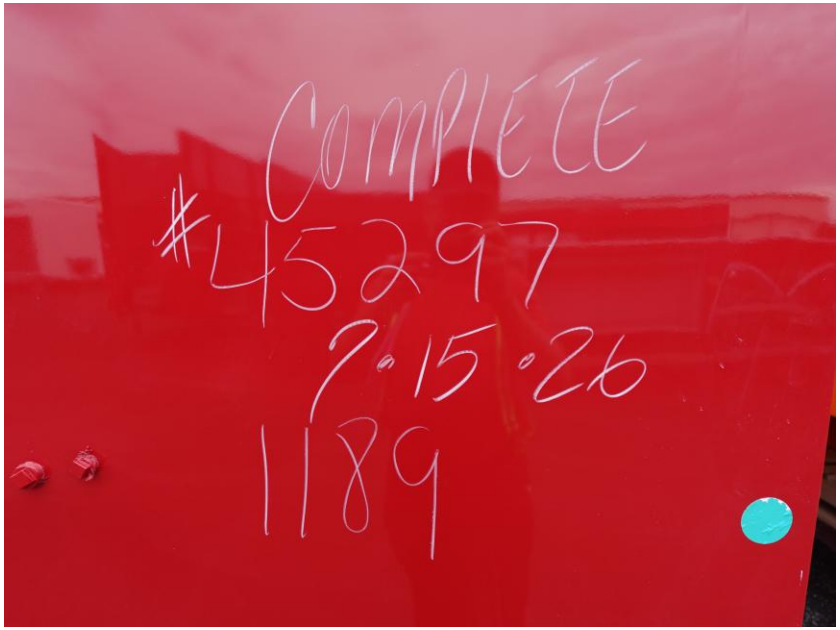

DSC06150



DSC06151



DSC06152



DSC06153



DSC06154



DSC06286



DSC06287



DSC06288



DSC06289



DSC06290

https://reliantfire.com/

Find us on Facebook

An Oshkosh Corporation Company